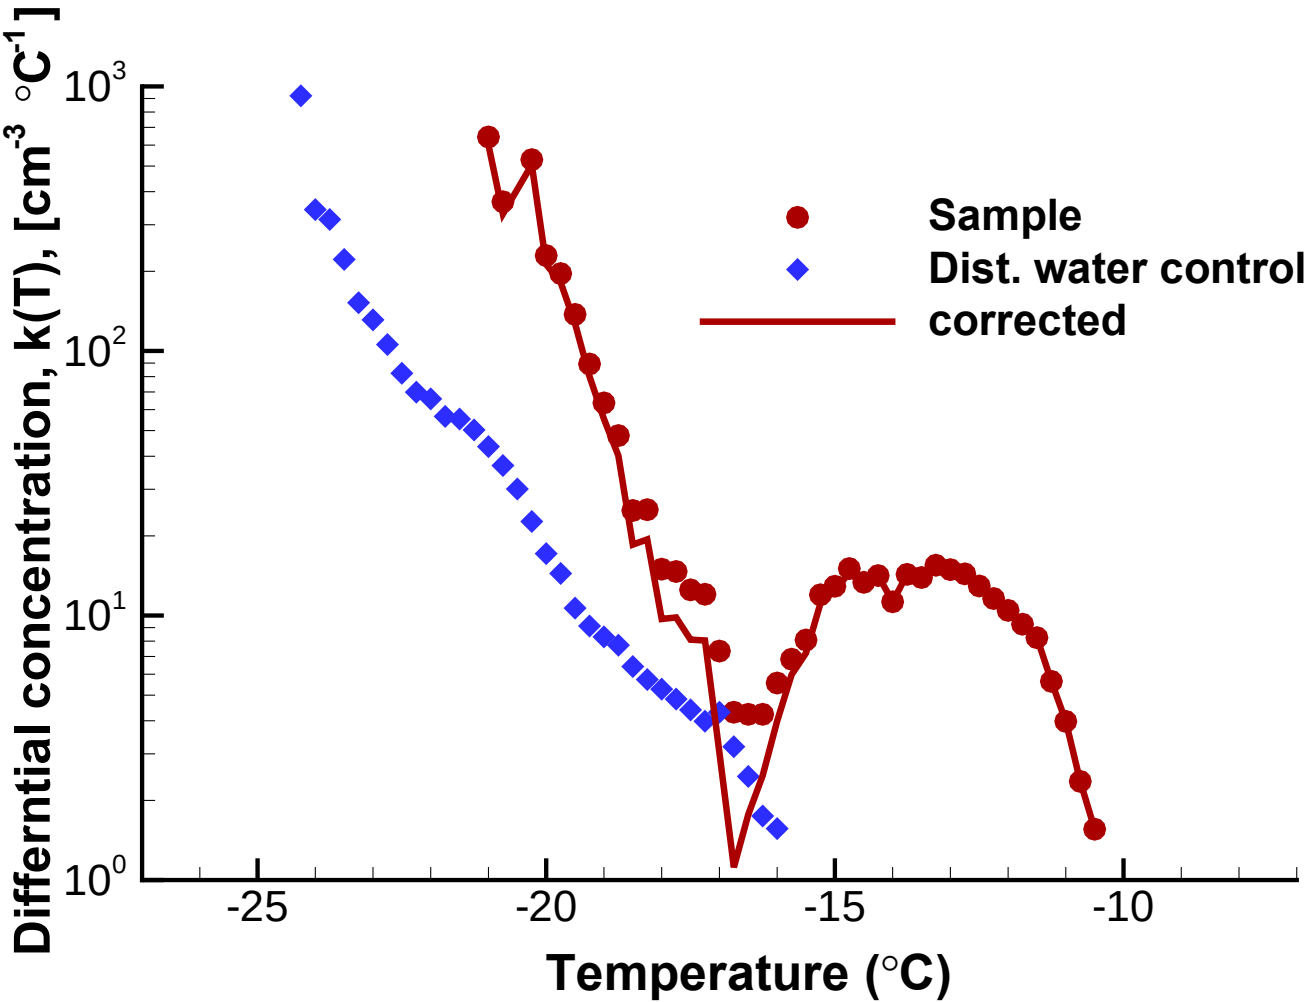
Differntial concentration, k(T), [cm^{-3} °C^{-1}]
10^3
10^2
10^1
10^0
-25
-20
-15
-10
Temperature (°C)
Sample
Dist. water control
corrected